

ADDENDUM NO. 8

WL-100 AREA ELEVATED STORAGE TANK PROJECT



NORTHWESTERN WATER AND SEWER DISTRICT

JANUARY 12, 2021

1. PLAN SHEET 1 of 4

- a. As requested, the existing site grades have been added to this plan sheet. Revision is attached.

END OF ADDENDUM

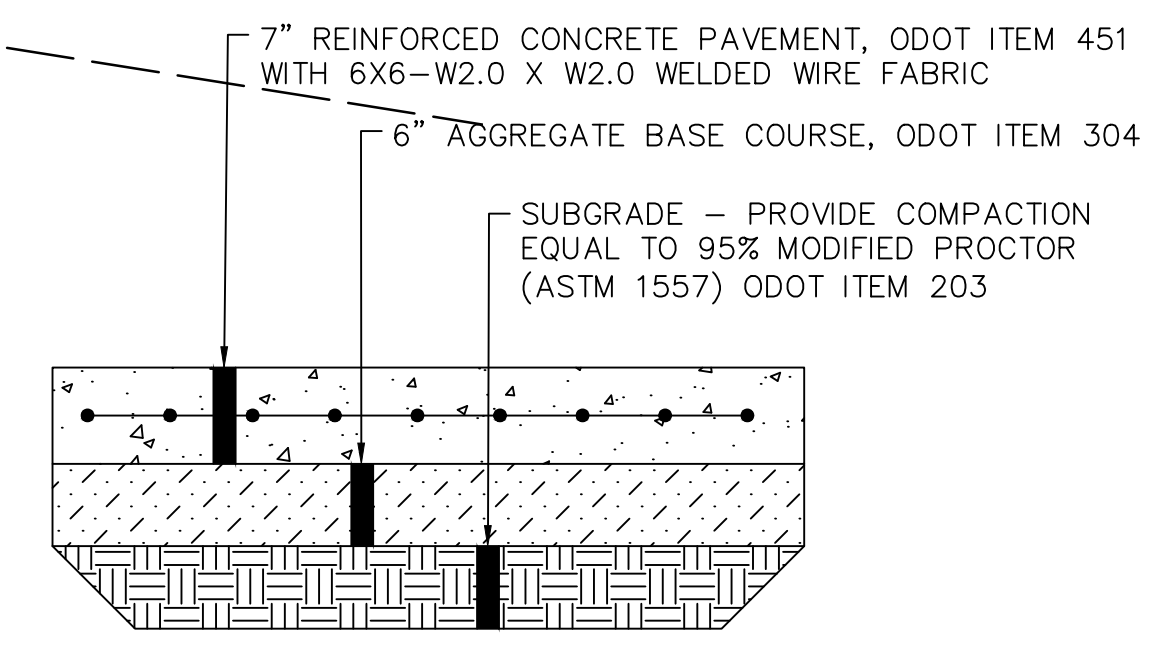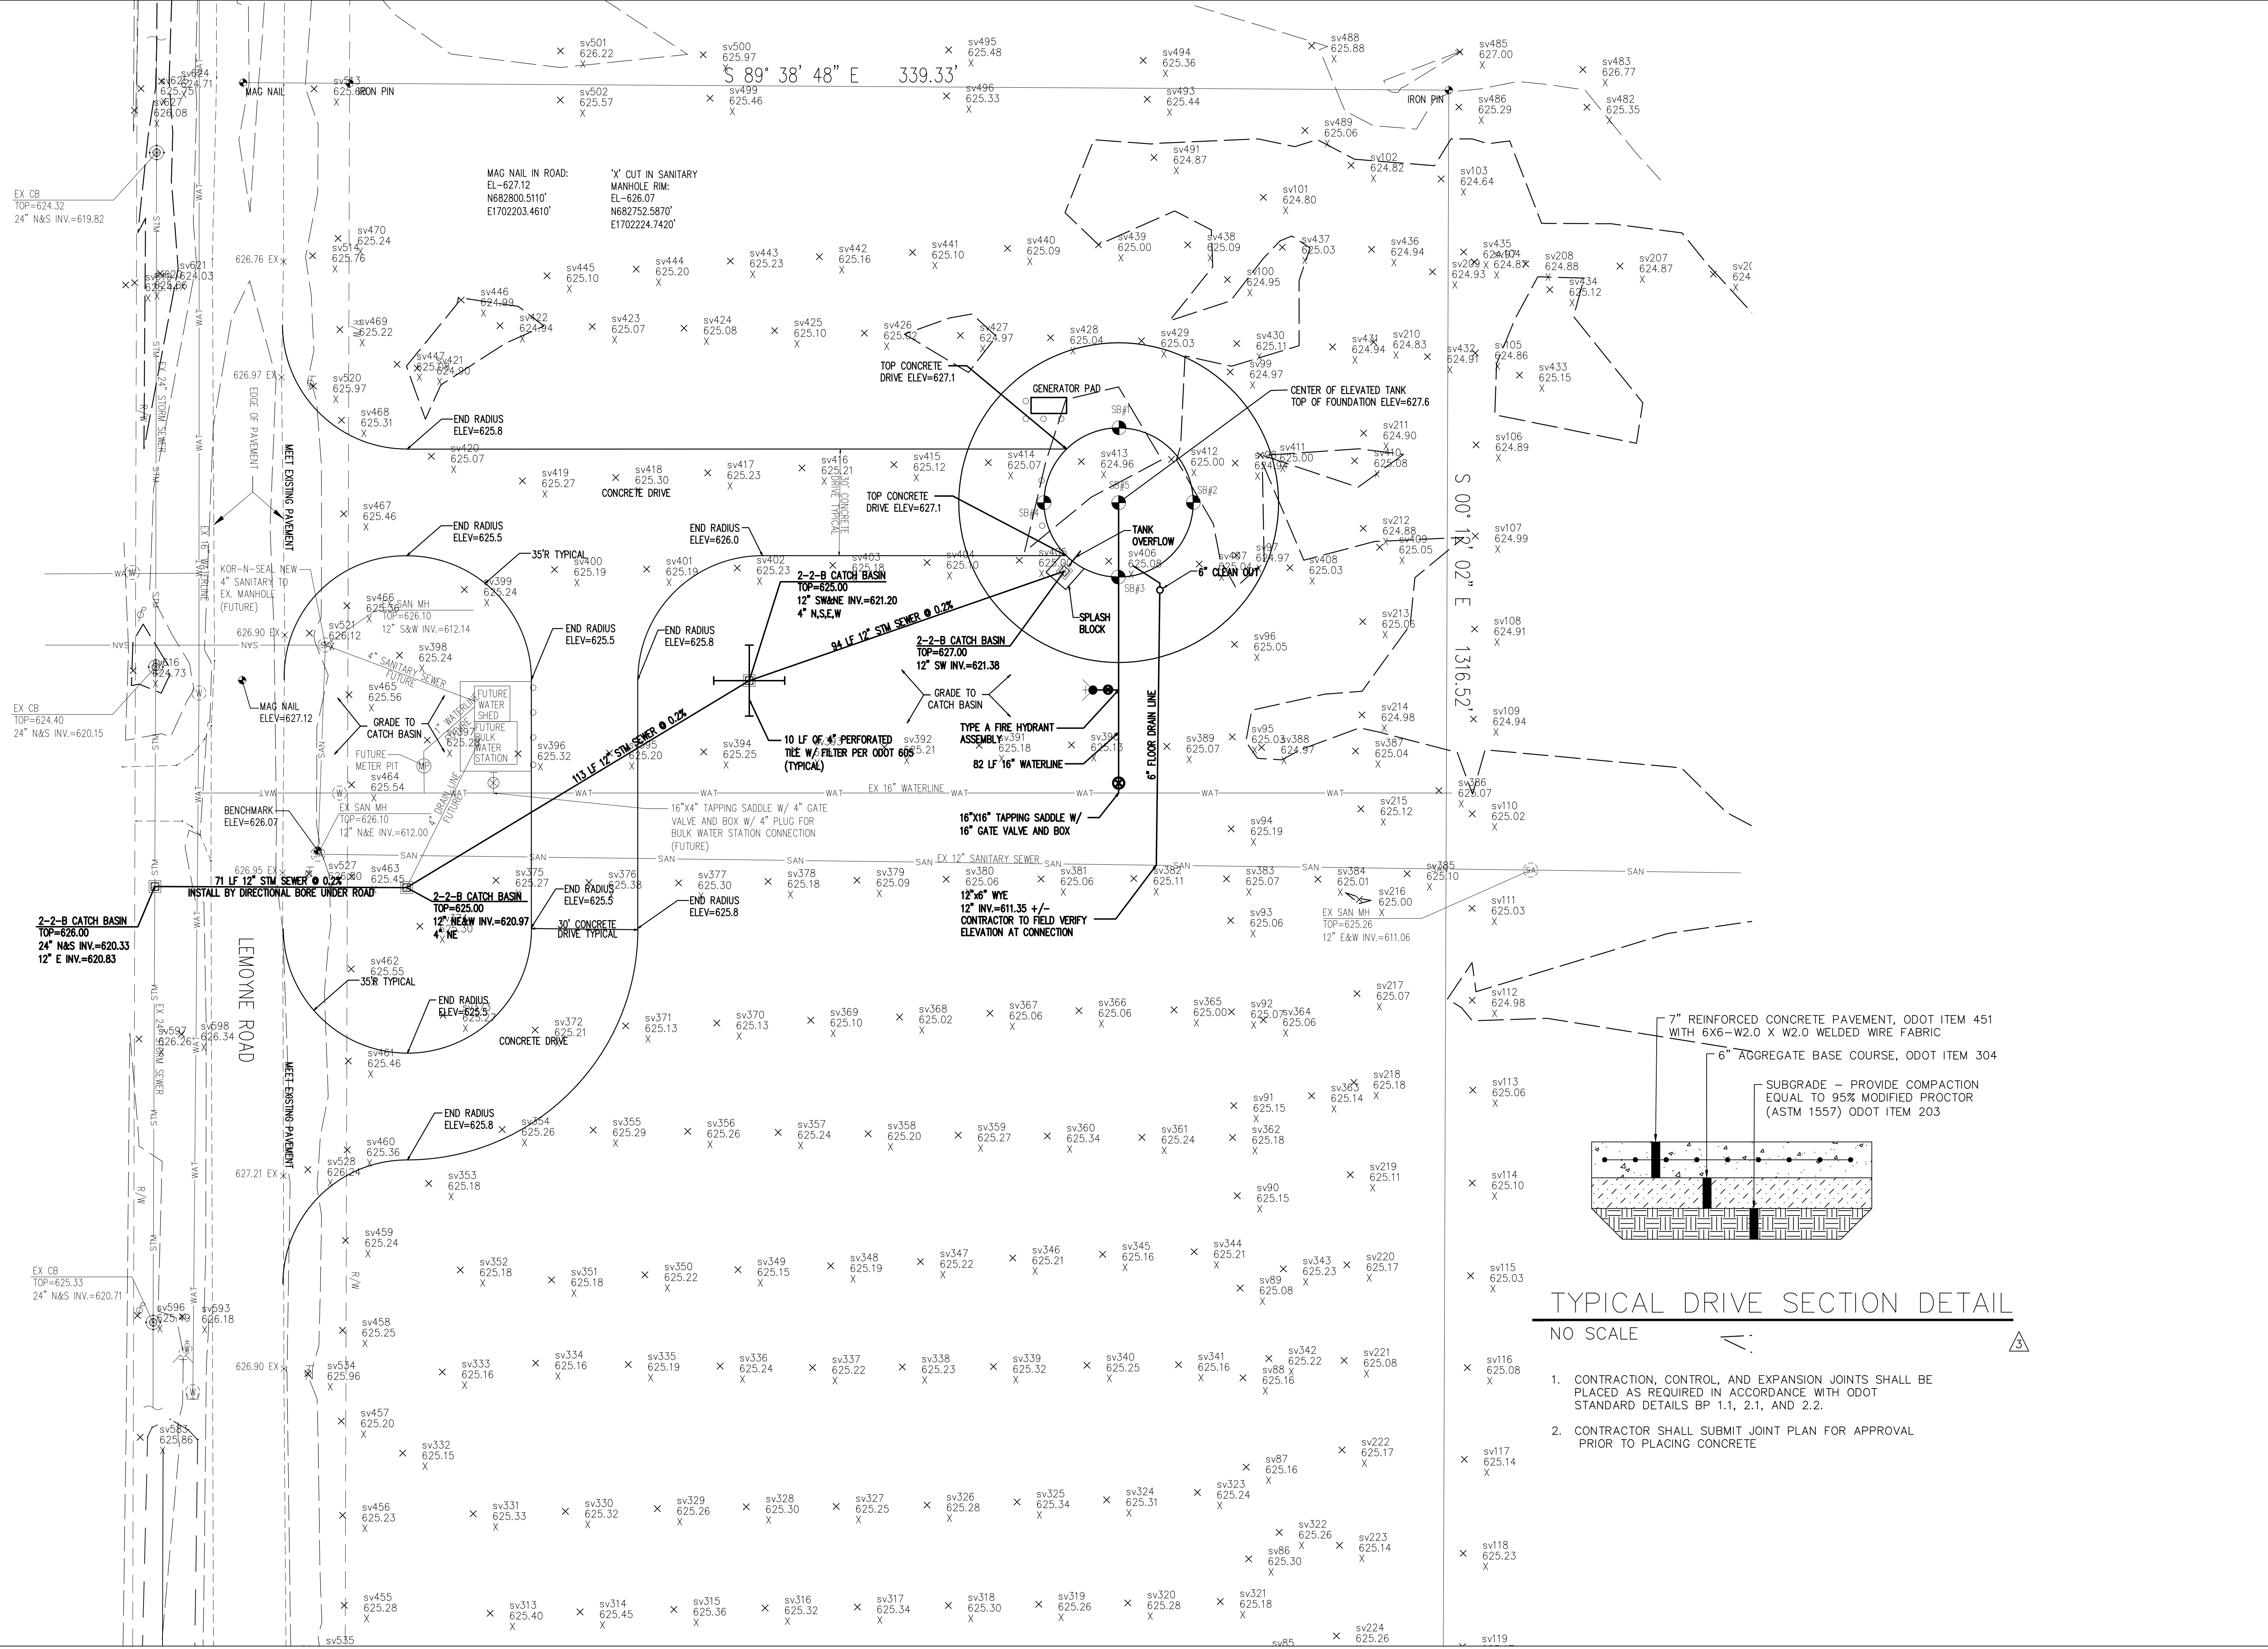

TYPICAL DRIVE SECTION DETAIL
NO SCALE

1. CONTRACTION, CONTROL, AND EXPANSION JOINTS SHALL BE PLACED AS REQUIRED IN ACCORDANCE WITH ODOT STANDARD DETAILS BP 1.1, 2.1, AND 2.2.
2. CONTRACTOR SHALL SUBMIT JOINT PLAN FOR APPROVAL PRIOR TO PLACING CONCRETE