


FIGURE 1 AREAS OF RESPONSIBILITY

NOTE: A Double Check Valve must be 1st item installed in Premises.
(See Item 1 of General Rules)

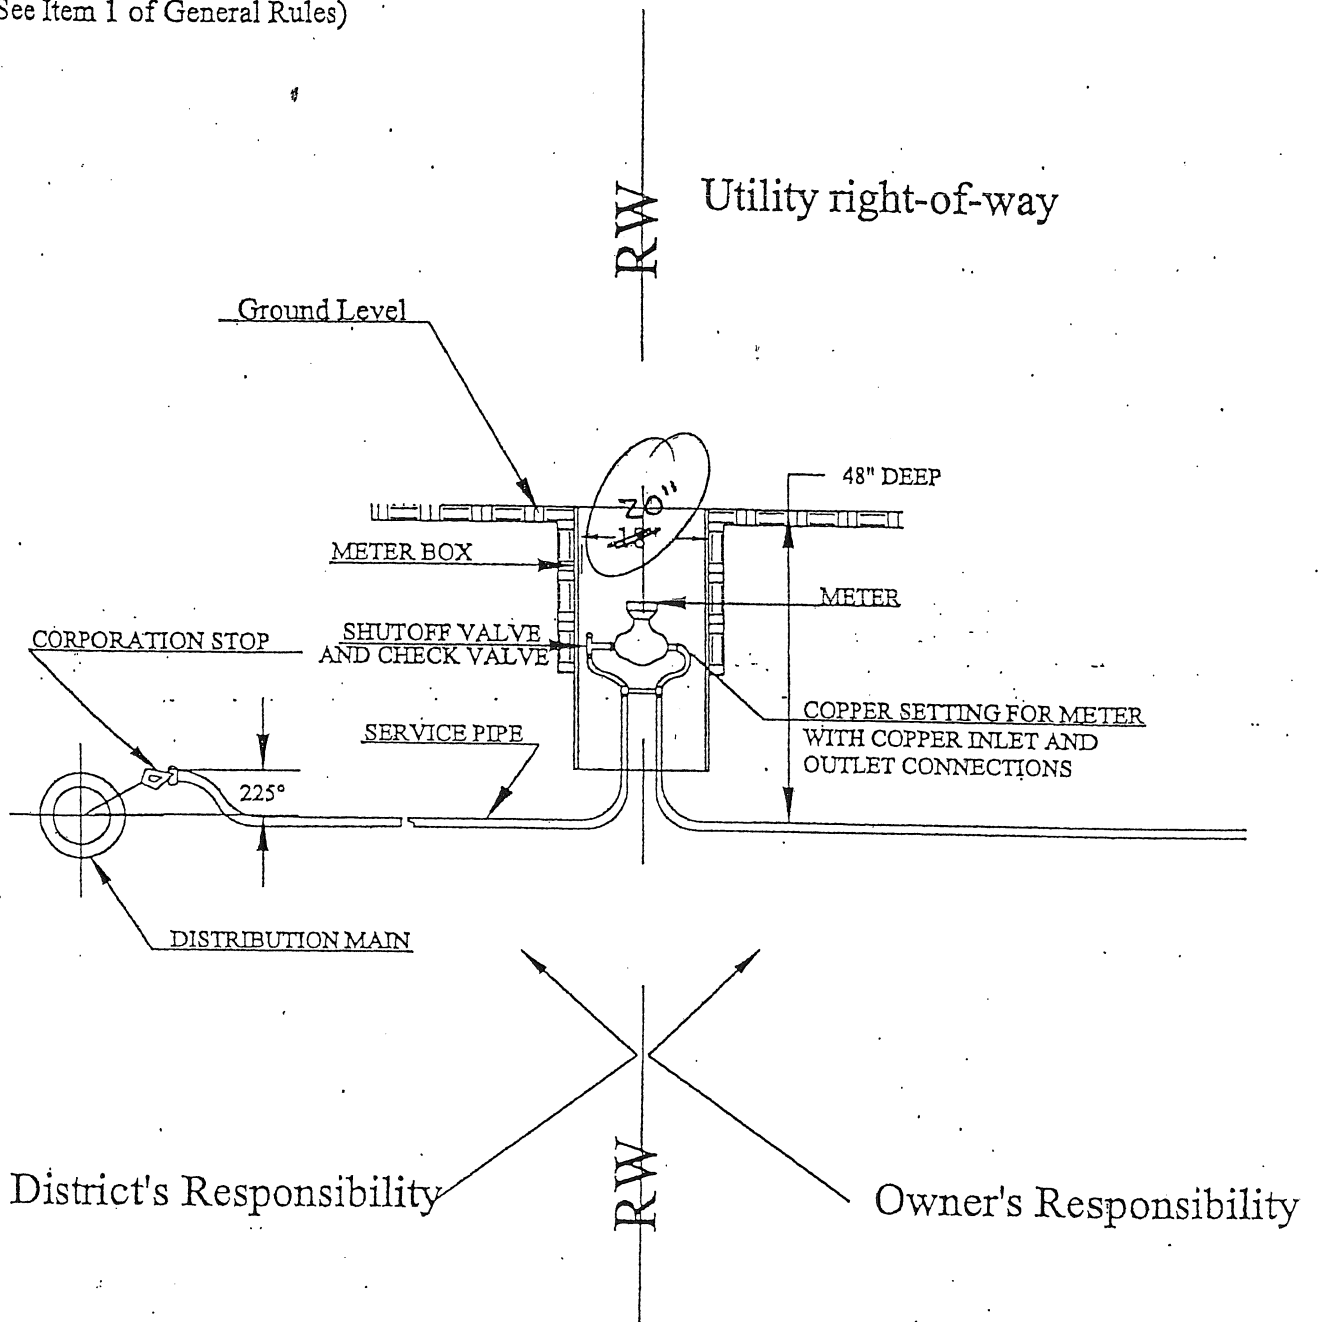

The customer is responsible for the installation and maintenance of the service line from the discharge side of the meter pit regardless of the meter pit location.